

Application

Ideal for use where Lead-Free* valves are required. Designed for installation on potable water lines to protect against both backsiphonage and backpressure of polluted water into the potable water supply. A test cock plug is provided to protect against fouling caused by insects, dirt and debris. Assembly shall provide protection where a potential non-health hazard exists.



Standards Compliance

(Unless otherwise noted, applies to horizontal and vertical flow-up installations)

- ASSE® Listed 1015
- cUPC® Listed
- CSA® Certified B64.5
- AWWA Compliant C510
- Approved by the Foundation for Cross Connection Control and Hydraulic Research at the University of Southern California (Horizontal installations only)
- Meets the requirements of NSF/ANSI/CAN 61 and 372*

*(0.25% MAX. WEIGHTED AVERAGE LEAD CONTENT)

Features

Sizes 3/4", 1", 1-1/4", 1-1/2", 2"

Maximum working water pressure 175 PSI

Maximum working water temperature 180°F

Hydrostatic test pressure 350 PSI

End connections (Threaded) ANSI B1.20.1



1" 950XLT2



2" 950XLT2

Materials

Main Valve Body	Low Lead Cast Bronze ASTM B584
Access Covers	Low Lead Cast Bronze ASTM B584
Ball Valve Handles	Stainless Steel
Elastomers	Buna Nitrile
	Silicone
Fasteners	300 series Stainless Steel
Polymers	NORYL™
Springs	300 series Stainless Steel
Test Cock Cover	Plastic

Options (Suffixes can be combined)


FT	With "Fast Test" test cocks
S	With Model SXL lead free bronze wye strainer

Accessories


Repair Kits (3/4" - 2")

Thermal Expansion Tank **XT**

Quick Test Fitting Set **QT-SET**

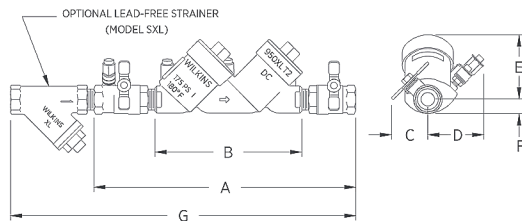

(3/4" - 1")

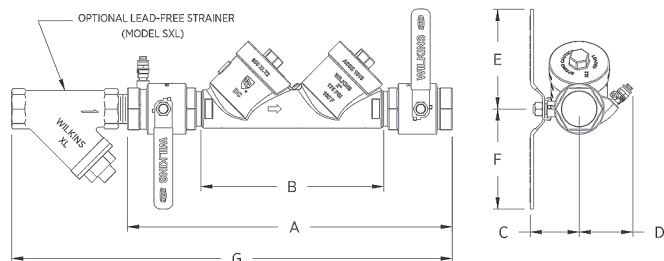

(1 1/4" - 2")

Dimensions & Weights (do not include pkg.)


MODEL SIZE		DIMENSIONS (approximate)														WEIGHT WITH BALL VALVES	
		A		B		C		D		E		F		G			
in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kg
3/4	20	13	330	8 3/4	222	2 3/8	60	2 5/16	59	3 5/16	84	3/4	19	17 5/8	448	6	2.7
1	25	14	356	8 3/4	222	2 1/2	64	2 5/16	59	3 5/16	84	3/4	19	19 3/4	502	12	5.4
1 1/4	32	19 5/8	499	13 3/4	349	2 1/2	64	3 5/8	92	5 5/8	143	5 5/8	143	24 3/4	629	22	10
1 1/2	40	20 5/16	516	13 3/4	349	3	76	3 5/8	92	5 5/8	143	5 5/8	143	25 15/16	659	22	10
2	50	21 3/8	543	13 3/4	349	3 1/2	89	3 5/8	92	6 1/2	165	6 1/2	165	28 5/16	719	29	13.2

Design and dimensional data (inches and [mm]) are subject to manufacturing tolerances and change without notice.

Flow Characteristics

◇ Rated Flow (established by approval agencies)


MODEL 950XLT2 3/4", 1", 1 1/4", 1 1/2" & 2" (STANDARD & METRIC)

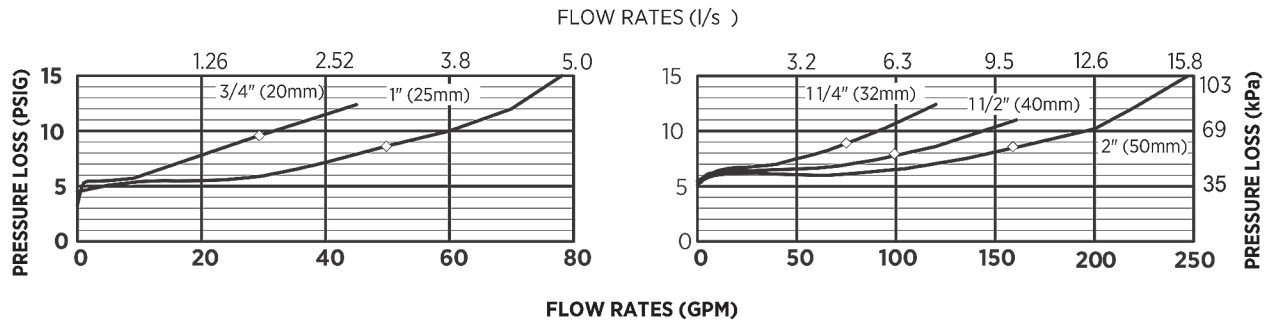


Typical Installation

Local codes shall govern installation requirements. To be installed in accordance with the manufacturer's instructions and the latest edition of the Uniform Plumbing Code. Unless otherwise specified, the assembly shall be mounted at a minimum of 12" (305mm) and a maximum of 30" (762mm) above adequate drains with sufficient side clearance for testing and maintenance. If installed below grade, be certain adequate drainage is provided to prevent the device from being submerged.

Capacity thru Schedule 40 Pipe				
Pipe size	5 ft/sec	7.5 ft/sec	10 ft/sec	15 ft/sec
1/8"	1	1	2	3
1/4"	2	2	3	5
3/8"	3	4	6	9
1/2"	5	7	9	14
3/4"	8	12	17	25
1"	13	20	27	40
1 1/4"	23	35	47	70
1 1/2"	32	48	63	95
2"	52	78	105	167

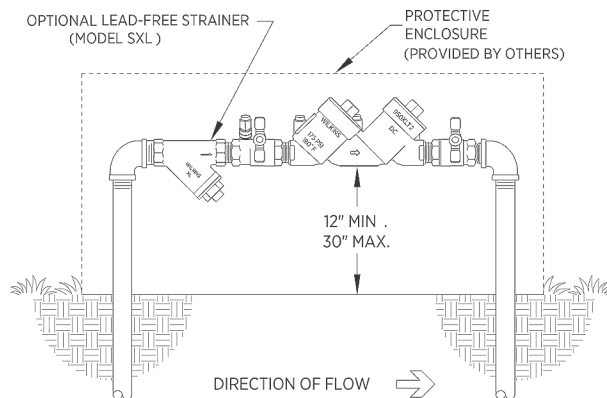

OUTDOOR INSTALLATION

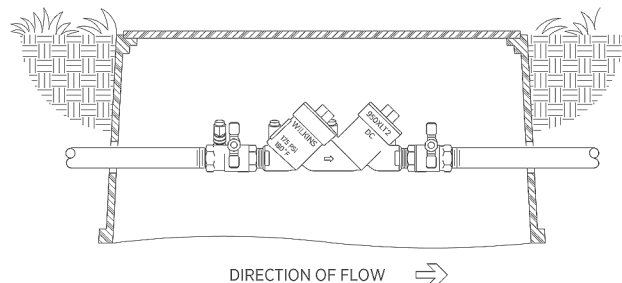

PIT INSTALLATION

[Installation and Maintenance Instructions - Model 950XLT2](#)

[Instructions for Freeze Protection - Model 950, 950XL, 975 & 975XL](#)

Specifications

The Double Check Type Backflow Preventer shall be certified to NSF/ANSI/CAN 61 and 372, shall be ASSE Listed 1015, rated to 180° F, and supplied with full port ball valves. The main body and access covers shall be low lead cast bronze (ASTM B 584), the seat ring and all internal polymers shall be NORYL™ and the seat disc elastomers shall be silicone. The first and second check shall be located at a 45° angle and accessible for maintenance from the top of the device, without removing the device from the line. Each check shall have separate access covers and test cocks shall be accessible from the top of the device. Test cocks shall be protected from debris by a plug. The Double Check Type Backflow Preventer shall be a WILKINS Model 950XLT2.